


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:119.99V I:0.1276A P:15.095W PF:0.9861 Freq:60.00Hz Lamp Flux:1295.45x1 lm		
NAME: R2ARDT-F835-WT	TYPE: Recessed-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 85.82 lm/W			
MODEL		Imax(cd)	2277	S/MH(C0/180)	0.62
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.62
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	1295.5	η UP,DN(C0-180)	0.0,50.8
NOMINAL FLUX(lm)	1295.45	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,49.1
LAMPS INSIDE	1	η up(%)	0.1	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	120	η down(%)	99.9	CIBSE SHR MAX	0.75

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM



C0 PLANE ISOLUX DIAGRAM (UNIT:lx)



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.464m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM


ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1673	1691	1707	1717	1736	1713	1685	1685	0- 10	182.9	182.9	14.1,14.1
20	1133	1158	1167	1147	1150	1127	1112	1123	10- 20	395.3	578.2	44.6,44.6
30	589.6	622.3	639.5	608.8	595.1	569.0	561.8	582.8	20- 30	386.9	965.1	74.5,74.5
40	98.36	112.6	111.3	102.5	94.85	92.30	90.11	89.79	30- 40	180.4	1146	88.4,88.4
50	54.78	56.85	57.24	56.19	56.09	54.73	53.89	54.19	40- 50	54.34	1200	92.6,92.6
60	37.54	39.07	39.15	39.25	39.73	38.12	37.22	37.22	50- 60	41.55	1241	95.8,95.8
70	22.29	22.23	23.22	24.64	25.84	25.36	24.67	23.98	60- 70	30.80	1272	98.2,98.2
80	8.108	7.944	8.546	9.539	11.13	11.36	10.67	9.526	70- 80	17.41	1290	99.6,99.6
90	0	0	0.0002	0.0032	0.3976	0.4602	0.1388	0	80- 90	4.700	1294	99.9,99.9
100	0	0	0	0	0	0	0	0	90-100	0.0065	1294	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0	1294	99.9,99.9
120	0.0071	0.0096	0.0054	0.0046	0.0132	0.0166	0.0196	0.0162	110-120	0.0014	1294	99.9,99.9
130	0.0890	0.0857	0.0841	0.0828	0.1516	0.1648	0.1708	0.1600	120-130	0.0508	1294	99.9,99.9
140	0.2168	0.2122	0.2063	0.2059	0.4200	0.4391	0.4437	0.4326	130-140	0.1670	1295	99.9,99.9
150	0.4122	0.4030	0.3972	0.3974	0.7190	0.7317	0.7408	0.7323	140-150	0.2772	1295	100,100
160	0.5586	0.5433	0.5392	0.5432	0.9436	0.9467	0.9556	0.9501	150-160	0.3034	1295	100,100
170	0.6681	0.6569	0.6543	0.6524	0.9941	0.9946	0.9961	0.9893	160-170	0.2254	1295	100,100
180	0.9109	0.9019	0.8970	0.8961	0.9033	0.9004	0.8955	0.8882	170-180	0.0807	1295	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.464m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

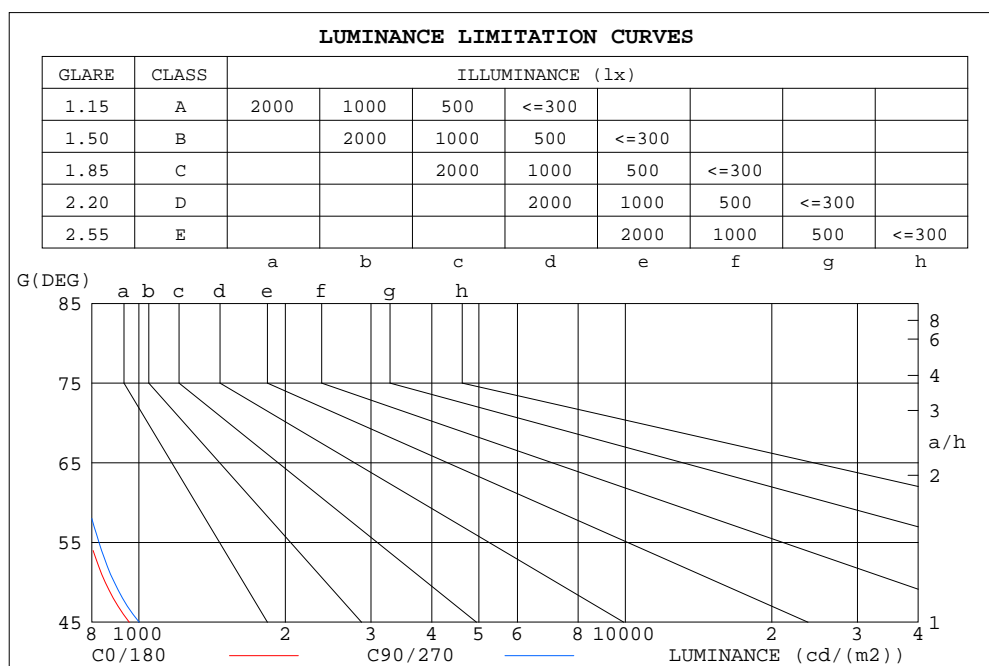


LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	345	383
80	467	492
75	554	576
70	652	679
65	707	740
60	751	783
55	796	828
50	853	890
45	956	1002

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.10	1.08	1.05	1.08	1.06	1.04	1.04	1.02	1.00	1.00	.99	.97	.97	.96	.94	.93
2.0	1.02	.98	.95	1.01	.97	.93	.97	.94	.91	.94	.92	.89	.91	.89	.88	.86
3.0	.95	.90	.86	.94	.89	.85	.91	.87	.84	.89	.86	.83	.87	.84	.81	.80
4.0	.89	.84	.79	.88	.83	.79	.86	.81	.78	.84	.80	.77	.82	.79	.76	.75
5.0	.84	.78	.74	.83	.77	.73	.81	.76	.73	.79	.75	.72	.78	.74	.71	.70
6.0	.79	.73	.69	.78	.73	.69	.77	.72	.68	.75	.71	.68	.74	.70	.67	.66
7.0	.75	.69	.65	.74	.68	.64	.73	.68	.64	.72	.67	.64	.70	.66	.63	.62
8.0	.71	.65	.61	.70	.65	.61	.69	.64	.60	.68	.64	.60	.67	.63	.60	.59
9.0	.67	.61	.58	.67	.61	.57	.66	.61	.57	.65	.60	.57	.64	.60	.57	.56
10.0	.64	.58	.55	.64	.58	.55	.63	.58	.54	.62	.57	.54	.61	.57	.54	.53



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0		
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0		
ρfc	20%			20%			20%			20%			20%			0		
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)											
0.0																		
1.0	.188	.107	.034	.182	.104	.033	.169	.097	.031	.157	.091	.029	.146	.085	.027			
2.0	.178	.098	.030	.172	.095	.029	.162	.090	.028	.152	.085	.027	.143	.081	.025			
3.0	.167	.089	.027	.163	.087	.026	.153	.083	.025	.145	.079	.024	.137	.076	.023			
4.0	.158	.082	.024	.153	.080	.024	.146	.077	.023	.138	.074	.022	.131	.071	.022			
5.0	.149	.076	.022	.145	.075	.022	.138	.072	.021	.132	.070	.021	.126	.067	.020			
6.0	.141	.071	.020	.138	.070	.020	.132	.067	.020	.126	.065	.019	.121	.064	.019			
7.0	.134	.066	.019	.131	.065	.019	.126	.064	.018	.121	.062	.018	.116	.060	.018			
8.0	.127	.062	.017	.125	.061	.017	.120	.060	.017	.116	.059	.017	.111	.057	.017			
9.0	.121	.059	.016	.119	.058	.016	.115	.057	.016	.111	.056	.016	.107	.054	.016			
10.0	.116	.056	.015	.114	.055	.015	.110	.054	.015	.107	.053	.015	.103	.052	.015			

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.191	.191	.191	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.173	.158	.145	.148	.135	.124	.101	.093	.086	.058	.054	.050	.019	.017	.016	
2.0	.158	.133	.112	.135	.115	.097	.093	.079	.068	.053	.046	.040	.017	.015	.013	
3.0	.145	.114	.089	.125	.099	.078	.086	.068	.054	.049	.040	.032	.016	.013	.011	
4.0	.135	.100	.073	.116	.086	.063	.080	.060	.044	.046	.035	.026	.015	.011	.009	
5.0	.126	.088	.060	.108	.076	.052	.075	.053	.037	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.050	.102	.068	.044	.070	.048	.031	.041	.028	.018	.013	.009	.006	
7.0	.112	.071	.043	.096	.062	.037	.066	.043	.026	.039	.025	.016	.012	.008	.005	
8.0	.106	.065	.037	.091	.056	.032	.063	.039	.023	.037	.023	.014	.012	.008	.004	
9.0	.100	.060	.032	.086	.052	.028	.060	.036	.020	.035	.021	.012	.011	.007	.004	
10.0	.095	.055	.028	.082	.048	.025	.057	.034	.018	.033	.020	.010	.011	.007	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	7.8	8.8	8.1	9.0	9.1	8.4	9.3	8.6	9.5	9.6
3H	8.6	9.5	8.8	9.7	9.9	9.0	9.9	9.3	10.1	10.3
4H	8.9	9.7	9.1	9.9	10.1	9.3	10.1	9.6	10.3	10.6
6H	9.0	9.8	9.3	10.1	10.3	9.4	10.2	9.7	10.5	10.7
8H	9.1	9.8	9.4	10.1	10.4	9.5	10.2	9.8	10.5	10.8
12H	9.1	9.8	9.4	10.1	10.4	9.5	10.2	9.8	10.5	10.8
4H 2H	8.1	8.9	8.4	9.2	9.4	8.5	9.4	8.8	9.6	9.8
3H	9.0	9.7	9.3	10.0	10.3	9.4	10.1	9.7	10.4	10.7
4H	9.4	10.1	9.7	10.4	10.7	9.7	10.4	10.1	10.7	11.0
6H	9.7	10.3	10.0	10.6	10.9	10.0	10.6	10.4	10.9	11.3
8H	9.7	10.3	10.1	10.6	11.0	10.1	10.6	10.5	11.0	11.3
12H	9.8	10.3	10.2	10.6	11.0	10.1	10.6	10.5	11.0	11.4
8H 4H	9.5	10.0	9.9	10.4	10.8	9.8	10.4	10.2	10.7	11.1
6H	9.9	10.3	10.3	10.7	11.1	10.2	10.6	10.6	11.0	11.4
8H	10.0	10.4	10.4	10.8	11.2	10.3	10.7	10.7	11.1	11.6
12H	10.0	10.4	10.5	10.8	11.3	10.4	10.7	10.8	11.1	11.6
12H 4H	9.5	10.0	9.9	10.4	10.7	9.8	10.3	10.2	10.7	11.1
6H	9.9	10.3	10.3	10.7	11.1	10.2	10.6	10.6	11.0	11.4
8H	10.0	10.3	10.5	10.8	11.3	10.3	10.6	10.8	11.1	11.6
Variations with the observer position at spacings:										
S = 1.0H	+ 0.5 / - 0.5					+ 0.9 / - 0.6				
1.5H	+ 0.9 / - 0.4					+ 1.8 / - 0.5				
2.0H	+ 0.3 / - 0.4					+ 0.3 / - 0.3				

CIE Pub.117, 1295 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 0.9$)

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	84	78	74	84	77	73	83	77	73	69
0.80	92	86	81	91	85	81	90	85	81	77
1.00	97	91	86	96	90	86	94	90	86	81
1.25	101	95	91	100	95	91	98	93	90	86
1.50	104	99	95	103	98	94	100	96	93	88
2.00	107	102	99	105	101	98	103	99	96	91
2.50	109	105	101	107	103	100	104	101	98	92
3.00	111	107	104	109	105	103	105	103	100	94
4.00	113	110	107	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	106	105	97
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.464m [K=1.0000]
Remarks:

AAI CURVES




Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.464m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:119.99V I:0.1276A P:15.095W PF:0.9861 Freq:60.00Hz Lamp Flux:1295.45x1 lm		
NAME: R2ARDT-F835-WT	TYPE: Recessed-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	741
L_0~180(75)av	632
L_0~180(85)av	473
L_90~270(65)av	731
L_90~270(75)av	629
L_90~270(85)av	472
L_45(65)av	736
L_45(75)av	630
L_45(85)av	472

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

Planar Illuminance Curve



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.464m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275	2275			
5	1995	2006	2025	2044	2062	2066	2070	2063	2093	2062	2033	2010	1998	1989	1999	2007			
10	1673	1683	1691	1703	1707	1709	1717	1714	1736	1726	1713	1695	1685	1680	1685	1691			
15	1407	1418	1433	1434	1441	1442	1431	1429	1452	1454	1438	1430	1419	1413	1410	1421			
20	1133	1149	1158	1166	1167	1161	1147	1139	1150	1144	1127	1118	1112	1115	1123	1143			
25	829	854	876	892	890	869	840	820	833	821	815	809	810	808	815	833			
30	590	611	622	635	639	626	609	586	595	581	569	561	562	571	583	598			
35	248	277	304	322	326	311	291	266	282	265	249	226	221	218	229	258			
40	98.4	107	113	114	111	108	103	97.6	94.8	93.6	92.3	91.2	90.1	89.7	89.8	93.0			
45	67.5	69.2	70.7	71.0	70.9	69.7	68.5	67.6	68.5	67.9	67.3	66.7	66.2	66.1	66.4	67.6			
50	54.8	55.7	56.8	57.1	57.2	56.8	56.2	55.7	56.1	55.5	54.7	54.1	53.9	54.0	54.2	55.0			
55	45.6	46.4	47.3	47.2	47.5	47.3	47.1	47.0	47.3	46.4	45.7	45.1	44.7	44.8	45.1	45.6			
60	37.5	38.2	39.1	38.9	39.1	39.2	39.3	39.5	39.7	38.9	38.1	37.6	37.2	37.1	37.2	37.6			
65	29.9	30.3	31.1	30.9	31.3	31.5	31.9	32.2	32.8	32.2	31.4	30.9	30.5	30.3	30.1	30.3			
70	22.3	22.1	22.2	22.5	23.2	24.0	24.6	25.2	25.8	25.7	25.4	25.0	24.7	24.2	24.0	23.6			
75	14.3	14.1	14.1	14.4	14.9	15.5	16.2	16.9	18.4	18.7	18.6	18.2	17.7	17.0	16.3	15.7			
80	8.11	7.93	7.94	8.17	8.55	9.02	9.54	10.1	11.1	11.4	11.4	11.1	10.7	10.1	9.53	9.01			
85	3.01	2.90	2.92	3.07	3.34	3.68	4.07	4.43	5.23	5.41	5.39	5.21	4.88	4.48	4.06	3.70			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.40	0.48	0.46	0.34	0.14	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.01			
125	0.04	0.04	0.04	0.04	0.03	0.03	0.03	0.03	0.06	0.07	0.07	0.07	0.08	0.07	0.07	0.07			
130	0.09	0.09	0.09	0.08	0.08	0.08	0.08	0.09	0.15	0.16	0.16	0.17	0.17	0.17	0.16	0.16			
135	0.15	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.28	0.29	0.30	0.30	0.30	0.30	0.29	0.28			
140	0.22	0.21	0.21	0.21	0.21	0.20	0.21	0.21	0.42	0.43	0.44	0.44	0.44	0.44	0.43	0.43			
145	0.32	0.32	0.31	0.31	0.31	0.31	0.31	0.31	0.57	0.58	0.59	0.59	0.59	0.59	0.58	0.58			
150	0.41	0.41	0.40	0.40	0.40	0.39	0.40	0.40	0.72	0.73	0.73	0.74	0.74	0.74	0.73	0.73			
155	0.48	0.47	0.47	0.47	0.47	0.47	0.47	0.47	0.85	0.85	0.85	0.86	0.86	0.86	0.86	0.85			
160	0.56	0.55	0.54	0.54	0.54	0.54	0.54	0.55	0.94	0.95	0.95	0.95	0.96	0.95	0.95	0.95			
165	0.62	0.61	0.61	0.61	0.61	0.61	0.61	0.61	1.00	1.00	1.00	1.01	1.01	1.00	1.00	1.00			
170	0.67	0.66	0.66	0.66	0.65	0.65	0.65	0.65	0.99	1.00	0.99	0.99	1.00	0.99	0.99	0.99			
175	0.79	0.78	0.77	0.77	0.77	0.77	0.77	0.77	0.95	0.96	0.95	0.95	0.95	0.95	0.95	0.94			
180	0.91	0.91	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.91	0.90	0.90	0.90	0.89	0.89	0.89			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks: