


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:120.07V I:0.1262A P:14.943W PF:0.9862 Freq:60.00Hz Lamp Flux:1319.49x1 lm		
NAME: R2ARDT-S835-WT	TYPE: Recessed-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 88.30 lm/W			
MODEL		Imax(cd)	6436	S/MH(C0/180)	0.30
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.30
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	1319.5	η UP,DN(C0-180)	0.0,51.1
NOMINAL FLUX(lm)	1319.49	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,48.8
LAMPS INSIDE	1	η up(%)	0.1	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)	120	η down(%)	99.9	CIBSE SHR MAX	1.00

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM



C0 PLANE ISOLUX DIAGRAM (UNIT:lx)



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.464m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM


ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2867	3000	2740	2513	2535	2395	2426	2669	0- 10	400.5	400.5	30.4,30.4
20	744.0	761.1	740.8	720.2	718.8	690.2	679.4	702.7	10- 20	358.1	758.6	57.5,57.5
30	477.0	475.4	475.8	458.1	455.8	453.7	465.2	479.7	20- 30	263.2	1022	77.4,77.4
40	98.57	89.73	90.33	83.23	88.64	87.98	89.62	91.70	30- 40	149.9	1172	88.8,88.8
50	63.50	61.29	63.58	56.46	58.56	58.88	65.66	63.75	40- 50	58.22	1230	93.2,93.2
60	35.09	34.03	33.55	32.84	34.62	34.48	35.22	35.50	50- 60	40.79	1271	96.3,96.3
70	20.92	21.02	21.18	21.63	22.62	22.95	22.63	22.11	60- 70	27.68	1298	98.4,98.4
80	7.723	8.112	8.611	8.943	9.535	9.285	8.707	8.257	70- 80	15.75	1314	99.6,99.6
90	0	0.0029	0.0012	0.0114	0.2211	0.0344	0	0	80- 90	4.210	1318	99.9,99.9
100	0	0	0	0	0	0	0	0	90-100	0.0034	1318	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0	1318	99.9,99.9
120	0.0033	0.0054	0.0046	0.0050	0.0102	0.0103	0.0098	0.0082	110-120	0.0006	1318	99.9,99.9
130	0.0588	0.0580	0.0598	0.0604	0.1161	0.1150	0.1102	0.1071	120-130	0.0355	1318	99.9,99.9
140	0.1833	0.1768	0.1782	0.1883	0.3476	0.3577	0.3447	0.3297	130-140	0.1221	1319	99.9,99.9
150	0.5051	0.4975	0.4975	0.5024	0.8588	0.8751	0.8709	0.8418	140-150	0.2841	1319	99.9,99.9
160	0.5740	0.5666	0.5610	0.5557	1.246	1.229	1.249	1.247	150-160	0.3762	1319	100,100
170	0.5627	0.5563	0.5479	0.5448	1.088	1.071	1.066	1.083	160-170	0.2521	1319	100,100
180	0.7031	0.6863	0.6594	0.6677	0.7017	0.6930	0.6783	0.6739	170-180	0.0718	1319	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.464m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

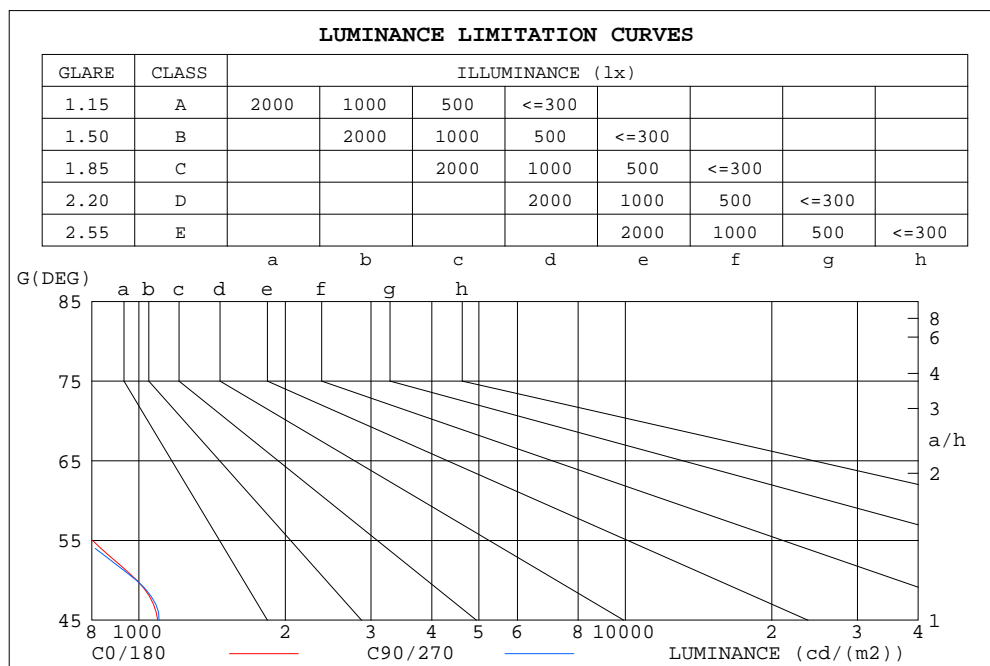


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.09	1.06	1.09	1.07	1.05	1.05	1.03	1.02	1.01	.00	.99	.98	.97	.96	.94
2.0	1.04	1.00	.97	1.02	.99	.96	.99	.96	.94	.96	.94	.92	.93	.92	.90	.88
3.0	.98	.93	.90	.97	.92	.89	.94	.90	.88	.92	.89	.86	.89	.87	.85	.83
4.0	.93	.88	.84	.92	.87	.83	.89	.85	.82	.87	.84	.81	.86	.83	.80	.79
5.0	.88	.83	.79	.87	.82	.79	.85	.81	.78	.84	.80	.77	.82	.79	.77	.75
6.0	.84	.79	.75	.83	.78	.75	.82	.77	.74	.80	.77	.74	.79	.76	.73	.72
7.0	.80	.75	.71	.80	.75	.71	.78	.74	.71	.77	.73	.70	.76	.73	.70	.69
8.0	.77	.72	.68	.77	.72	.68	.75	.71	.68	.75	.71	.68	.74	.70	.67	.66
9.0	.74	.69	.66	.74	.69	.66	.73	.68	.65	.72	.68	.65	.71	.68	.65	.64
10.0	.71	.67	.63	.71	.66	.63	.70	.66	.63	.70	.66	.63	.69	.65	.63	.62



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.172	.098	.031	.165	.094	.030	.153	.088	.028	.141	.081	.026	.130	.076	.024		
2.0	.161	.088	.027	.156	.086	.026	.145	.081	.025	.135	.076	.024	.126	.072	.023		
3.0	.151	.080	.024	.146	.078	.024	.137	.074	.023	.129	.071	.022	.121	.067	.021		
4.0	.141	.073	.022	.137	.072	.021	.130	.069	.021	.122	.066	.020	.116	.063	.019		
5.0	.133	.068	.020	.129	.066	.019	.123	.064	.019	.116	.061	.018	.111	.059	.018		
6.0	.125	.063	.018	.122	.062	.018	.116	.060	.017	.111	.058	.017	.106	.056	.017		
7.0	.118	.058	.017	.116	.058	.016	.111	.056	.016	.106	.054	.016	.101	.053	.015		
8.0	.112	.055	.015	.110	.054	.015	.105	.053	.015	.101	.051	.015	.097	.050	.015		
9.0	.107	.052	.014	.104	.051	.014	.101	.050	.014	.097	.049	.014	.093	.047	.014		
10.0	.102	.049	.014	.100	.048	.013	.096	.047	.013	.093	.046	.013	.090	.045	.013		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)										
0.0	.191	.191	.191	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.158	.146	.147	.136	.126	.100	.093	.087	.058	.054	.051	.018	.017	.016		
2.0	.156	.133	.114	.133	.115	.099	.091	.079	.069	.053	.046	.040	.017	.015	.013		
3.0	.142	.114	.092	.122	.098	.080	.084	.068	.056	.048	.040	.033	.016	.013	.011		
4.0	.131	.099	.075	.112	.086	.065	.077	.060	.046	.045	.035	.027	.014	.011	.009		
5.0	.121	.087	.062	.104	.076	.054	.072	.053	.038	.042	.031	.023	.013	.010	.007		
6.0	.113	.078	.053	.097	.067	.046	.067	.047	.032	.039	.028	.019	.013	.009	.006		
7.0	.106	.070	.045	.091	.061	.039	.063	.042	.028	.036	.025	.016	.012	.008	.005		
8.0	.099	.063	.039	.085	.055	.034	.059	.039	.024	.034	.023	.014	.011	.007	.005		
9.0	.094	.058	.034	.081	.050	.030	.056	.035	.021	.033	.021	.013	.011	.007	.004		
10.0	.089	.053	.030	.076	.046	.026	.053	.033	.018	.031	.019	.011	.010	.006	.004		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	7.3	8.2	7.6	8.3	8.5	7.1	7.9	7.3	8.1	8.3
3H	8.1	8.8	8.3	9.0	9.2	7.9	8.6	8.1	8.8	9.0
4H	8.4	9.1	8.6	9.3	9.5	8.2	9.0	8.5	9.2	9.4
6H	8.5	9.2	8.8	9.5	9.7	8.5	9.2	8.8	9.4	9.7
8H	8.6	9.3	8.9	9.5	9.8	8.5	9.2	8.8	9.5	9.7
12H	8.6	9.3	8.9	9.5	9.8	8.6	9.2	8.9	9.5	9.8
4H 2H	7.6	8.3	7.8	8.5	8.7	7.3	8.1	7.6	8.3	8.5
3H	8.5	9.1	8.8	9.4	9.7	8.3	9.0	8.6	9.2	9.5
4H	8.9	9.5	9.2	9.8	10.1	8.8	9.4	9.1	9.7	10.0
6H	9.2	9.7	9.5	10.0	10.4	9.1	9.7	9.5	10.0	10.3
8H	9.2	9.7	9.6	10.1	10.5	9.3	9.8	9.7	10.1	10.5
12H	9.3	9.7	9.7	10.1	10.5	9.3	9.8	9.7	10.2	10.5
8H 4H	9.0	9.5	9.4	9.8	10.2	8.9	9.4	9.3	9.8	10.1
6H	9.4	9.8	9.8	10.2	10.6	9.4	9.8	9.8	10.2	10.6
8H	9.5	9.9	10.0	10.3	10.7	9.5	9.9	10.0	10.3	10.8
12H	9.6	9.9	10.1	10.3	10.8	9.7	10.0	10.1	10.4	10.9
12H 4H	9.0	9.4	9.4	9.8	10.2	8.9	9.3	9.3	9.7	10.1
6H	9.4	9.8	9.8	10.2	10.6	9.4	9.7	9.8	10.2	10.6
8H	9.5	9.9	10.0	10.3	10.8	9.6	9.9	10.1	10.3	10.8
Variations with the observer position at spacings:										
S = 1.0H	+ 0.6 / - 0.5					+ 0.4 / - 0.5				
1.5H	+ 1.0 / - 0.3					+ 0.4 / - 0.2				
2.0H	+ 0.7 / - 0.5					+ 0.8 / - 0.6				

CIE Pub.117, 1319 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 1.0$)

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	85	78	74	84	78	74	83	77	74	70
0.80	92	86	82	92	85	82	90	85	81	77
1.00	97	91	87	96	90	87	94	90	86	82
1.25	101	95	92	100	95	91	98	94	90	86
1.50	104	99	95	103	98	95	100	97	94	89
2.00	107	102	99	106	101	98	103	99	97	91
2.50	109	105	102	107	104	101	104	101	99	93
3.00	111	107	104	109	106	103	105	103	101	94
4.00	113	110	107	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	107	105	97
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.464m [K=1.0000]
Remarks:

AAI CURVES




Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:120.07V I:0.1262A P:14.943W PF:0.9862 Freq:60.00Hz Lamp Flux:1319.49x1 lm		
NAME: R2ARDT-S835-WT	TYPE: Recessed-mounted Luminaire	HEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	665
L_0~180(75)av	568
L_0~180(85)av	423
L_90~270(65)av	660
L_90~270(75)av	569
L_90~270(85)av	424
L_45(65)av	660
L_45(75)av	569
L_45(85)av	424

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks:

Planar Illuminance Curve



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.464m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411	6411			
5	5321	5423	5447	5384	5254	5093	4929	4772	4828	4739	4710	4741	4835	4984	5160	5361			
10	2867	2990	3000	2884	2740	2617	2513	2406	2535	2448	2395	2388	2426	2534	2669	2910			
15	1263	1325	1327	1284	1234	1216	1219	1190	1196	1135	1094	1071	1057	1087	1150	1260			
20	744	760	761	753	741	724	720	713	719	707	690	682	679	683	703	735			
25	576	582	581	574	569	562	561	559	559	560	556	555	553	556	566	578			
30	477	478	475	478	476	466	458	447	456	453	454	462	465	475	480	484			
35	253	250	243	228	214	204	194	189	209	210	209	214	222	237	260	271			
40	98.6	97.1	89.7	88.4	90.3	83.7	83.2	85.3	88.6	88.6	88.0	89.0	89.6	89.9	91.7	96.0			
45	77.1	75.7	75.5	77.0	77.8	74.8	73.2	73.7	75.4	75.1	75.3	78.8	81.1	78.5	76.9	78.0			
50	63.5	61.9	61.3	63.1	63.6	58.7	56.5	56.4	58.6	58.4	58.9	62.3	65.7	63.7	63.7	65.4			
55	45.9	45.3	44.6	45.0	44.6	42.2	41.4	42.2	43.7	43.8	43.5	44.8	46.0	45.6	46.2	47.5			
60	35.1	34.7	34.0	33.7	33.6	32.8	32.8	33.5	34.6	34.6	34.5	34.9	35.2	35.2	35.5	35.9			
65	28.1	27.7	27.3	27.0	26.8	26.7	26.9	27.2	28.1	28.3	28.5	28.8	29.0	28.9	28.9	28.9			
70	20.9	20.9	21.0	21.1	21.2	21.4	21.6	21.9	22.6	22.8	22.9	22.9	22.6	22.4	22.1	22.1			
75	13.5	13.6	13.9	14.2	14.5	14.8	15.0	15.1	15.9	15.8	15.7	15.3	14.9	14.6	14.3	14.3			
80	7.72	7.87	8.11	8.38	8.61	8.80	8.94	9.01	9.53	9.47	9.29	9.03	8.71	8.42	8.26	8.21			
85	2.96	3.11	3.31	3.53	3.71	3.86	3.96	4.00	4.42	4.33	4.16	3.93	3.68	3.47	3.34	3.32			
90	0.00	0.00	0.00	0.00	0.00	0.02	0.01	0.02	0.22	0.13	0.03	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01			
125	0.03	0.02	0.03	0.03	0.02	0.03	0.03	0.03	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05			
130	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.12	0.12	0.11	0.11	0.11	0.11	0.11	0.10			
135	0.10	0.10	0.10	0.10	0.10	0.10	0.11	0.11	0.21	0.21	0.21	0.21	0.21	0.21	0.20	0.19			
140	0.18	0.18	0.18	0.18	0.18	0.18	0.19	0.20	0.35	0.35	0.36	0.35	0.34	0.34	0.33	0.32			
145	0.34	0.34	0.34	0.33	0.34	0.34	0.35	0.36	0.57	0.58	0.59	0.58	0.57	0.56	0.55	0.53			
150	0.51	0.50	0.50	0.49	0.50	0.50	0.50	0.51	0.86	0.87	0.88	0.88	0.87	0.86	0.84	0.82			
155	0.56	0.55	0.55	0.55	0.55	0.55	0.55	0.54	1.11	1.11	1.12	1.12	1.13	1.12	1.11	1.09			
160	0.57	0.57	0.57	0.57	0.56	0.56	0.56	0.56	1.25	1.24	1.23	1.24	1.25	1.25	1.25	1.24			
165	0.57	0.57	0.56	0.56	0.56	0.56	0.56	0.56	1.24	1.23	1.23	1.22	1.23	1.24	1.24	1.24			
170	0.56	0.56	0.56	0.55	0.55	0.54	0.54	0.55	1.09	1.09	1.07	1.06	1.07	1.08	1.08	1.10			
175	0.60	0.60	0.59	0.59	0.59	0.58	0.58	0.58	0.87	0.87	0.85	0.84	0.84	0.85	0.86	0.86			
180	0.70	0.69	0.69	0.68	0.66	0.66	0.67	0.68	0.70	0.70	0.69	0.68	0.68	0.67	0.67	0.68			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-04-02

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.464m [K=1.0000]
 Remarks: